


4100566 - HARDI 20 PIN LAYOUT

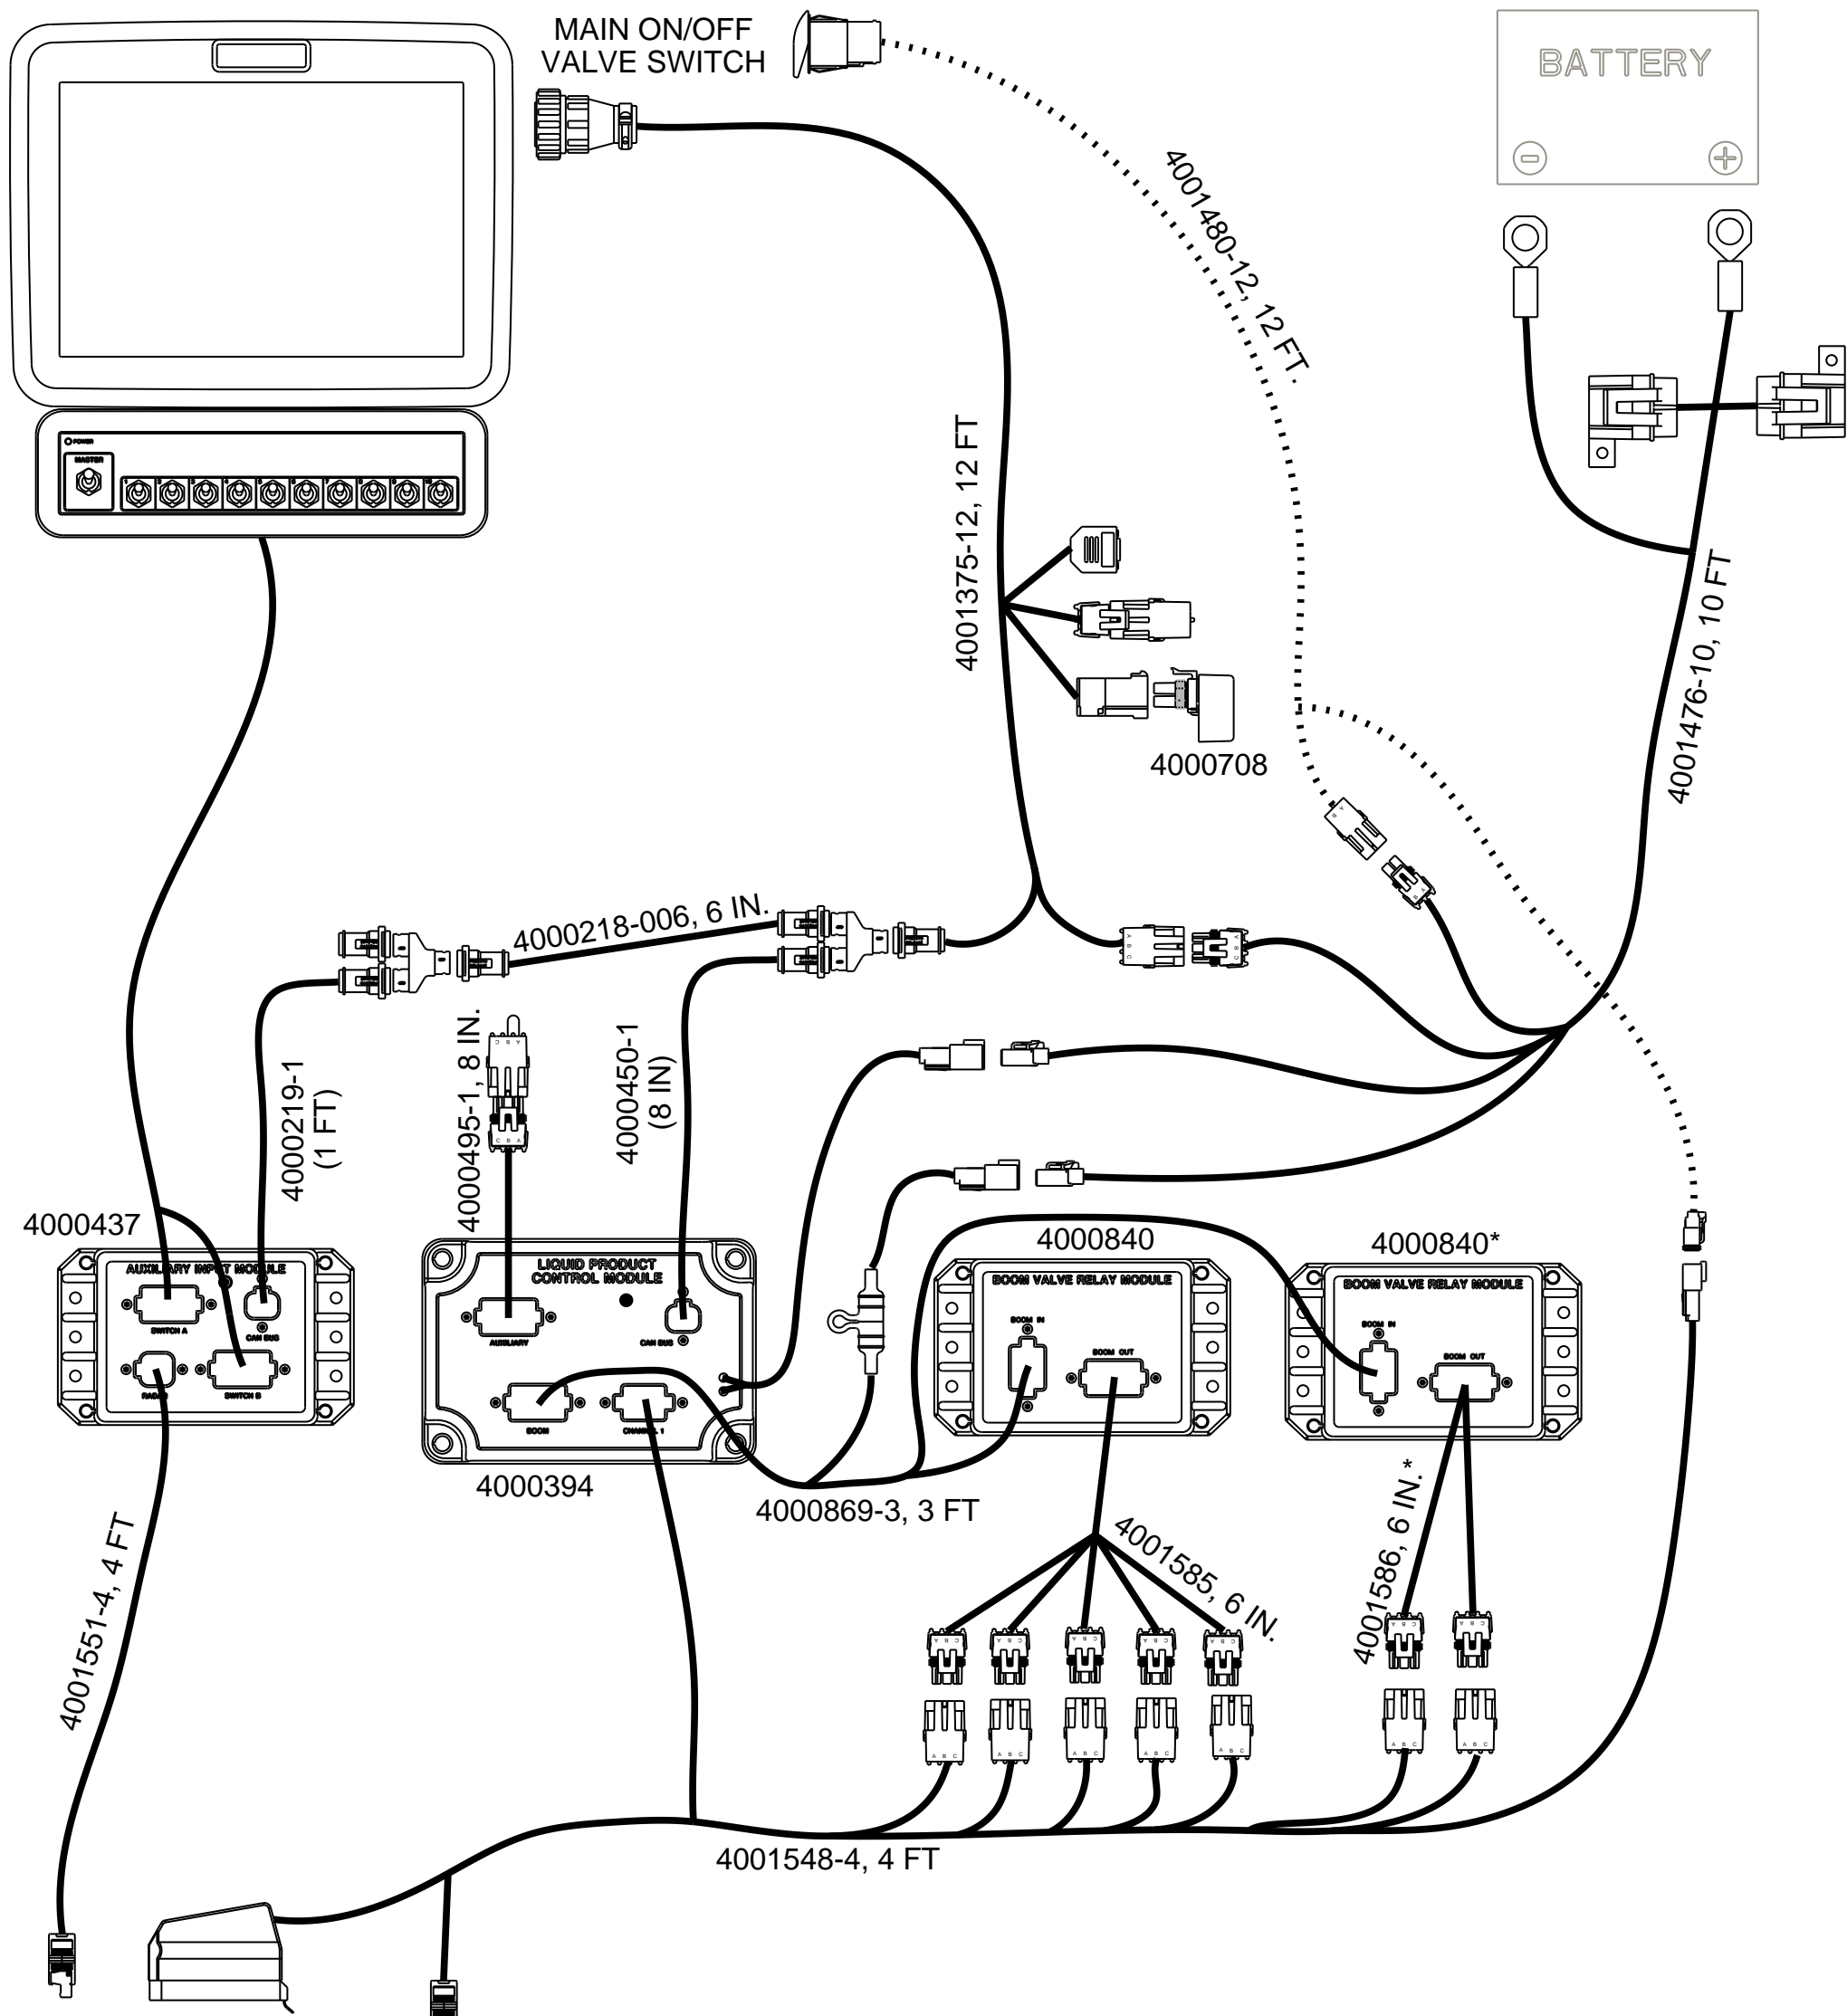

NOTES:

1. BLACK ITEMS ARE AG LEADER COMPONENTS
2. GRAY ITEMS ARE HARDI COMPONENTS
3. SECOND BOOM VALVE RELAY MODULE IS ONLY REQUIRED FOR 6 AND 7 SECTION APPLICATIONS AND MUST BE ORDERED SEPERATELY
4. 4001586 IS ONLY REQUIRED WITH 6 AND 7 SECTION APPLICATIONS AND IS INCLUDED IN THE SPRAYER KIT

SPEED SENSOR

FLOW CONTROL

FLOW METER

MAIN ON/OFF

BOOM VALVES